



REF. NO.	NOMENCLATURE & MATERIAL	
	TEMP. CLASSES TO 750°F (399°C)	
1	BASE	SA216 WCC CARBON STEEL
1A	INLET NECK	SA105 CARBON STEEL
2	DISC HOLDER	LEADED NICKEL SILVER
3	GUIDE	LEADED NICKEL SILVER
4	UPPER ADJ. RING	STAINLESS STEEL
5	SPRING	CARBON OR ALLOY STEEL
6	COVER PLATE STUD	B7 ALLOY STEEL
7	SEAT BUSHING	STAINLESS STEEL
8	DISC	INCONEL X-750
9	LOWER ADJ. RING	STAINLESS STEEL
10	DISC COLLAR	STAINLESS STEEL
11	LIFT STOP	STAINLESS STEEL
12	OVERLAP COLLAR	STAINLESS STEEL
13A	COVER PLATE ASSY	WC6 ALLOY STEEL
13B	COVER PLATE	MONEL
13C	FLOATING WASHER	STAINLESS STEEL
13D	WASHER RETAINER	2H CARBON STEEL
14	TOP PLATE ASSY	F11 ALLOY STEEL
14A	TOP PLATE	B7 ALLOY STEEL
14B	WASHER RETAINER	STAINLESS STEEL
14C	FLOATING WASHER	MONEL
15	SPINDLE	STAINLESS STEEL
16	COMPRESSION SCREW	SILICON BRASS
17	YOKE	SA216 WCC CARBON STEEL
18	YOKE ROD	2H CARBON STEEL
19	YOKE ROD NUT	B7 ALLOY STEEL
20	LIFTING GEAR	IRON OR STEEL
21	UPPER ADJ. RING PIN	STAINLESS STEEL
22	LOWER ADJ. RING PIN	STAINLESS STEEL
23	COMP. SCREW LOCKNUT	SILICON BRASS
24	UPPER SPRING WASHER	CARBON STEEL
25	LOWER SPRING WASHER	CARBON STEEL
26	WEATHER SHIELD	CARBON STEEL

* = RECOMMENDED SPARE PARTS. SEE MAINTENANCE MANUAL FOR QUANTITY.

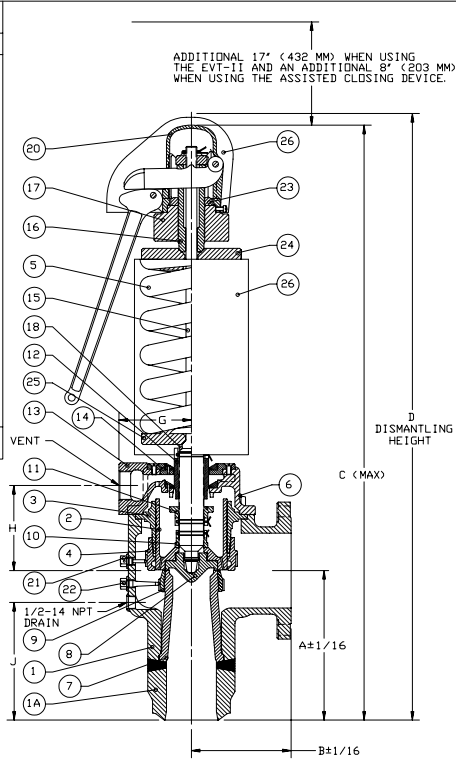

NOOTER/ERIKSEN COGEN SYSTEMS INC.
P.O. NO. 21481
DRESSER ORDER NO. 22-32916-0

Qty	Valve Size and Type	Dresser Item No.	Set Press. PSIG \ BARG	Temp. °F \ °C	Capacity LBS./HR \ KG/HR	TAG No.
2	2" 1727WB-2-S-100-F3-WSC	001	1700 \ 117.2	SAT \ SAT	115496 \ 14.55	XSGA-PSV-1001A XSGA-PSV-2001A

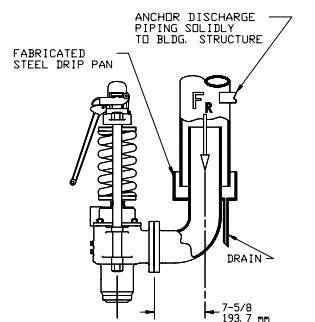

- NOTES
- STEAM FLOW WILL OCCUR THRU THE COVERPLATE VENT WHEN THE VALVE IS IN THE OPEN POSITION-DO NOT PLUG-PIPE TO SAFE LOCATION. REFER TO MAINTENANCE MANUAL FOR INSTRUCTIONS.
 - APPROPRIATE CONSIDERATIONS SHOULD BE MADE FOR DRAINING ANY CONDENSATE WHICH MAY ACCUMULATE IN THE LOWER PLATE VENT PIPING.

TYPICAL VALVE DESIGNATION

X - 1700WB - X - 100 - S


INLET SIZE

TYPE NUMBER


INTERCHANGEABILITY NO.

WELD END NUMBER

COMPENSATED BACK PRESSURE CLOSING DESIGN



CAP AND LEVER MAY BE ROTATED 45° HORIZONTALLY TO EITHER SIDE OF CENTERLINE. FOR LEVER CLEARANCE SEE DRAWING 214789.

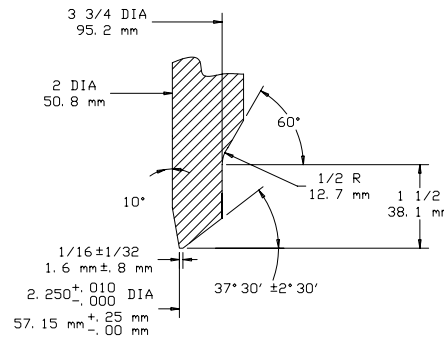

WELD END 250 RMS FINISH ALL OVER BUTT WELD

2	FX450	LRW	LRW	DMS	05/16/05
REV.	REL. NO.	DWN. BY	OKD. BY	ENG. APP.	DATE
CERTIFIED:		J. D. FOSTER			
1700					
CONSOLIDATED SAFETY VALVE					
					
MKT. DWG. #11636-001, REV. 01					
VALVE TYPE		2-1727WB-2-S-100-F3-WSC			
DWG. NO.		41027B100F3WS			
					REV. 2

ERIKSEN
Flow Control
ALEXANDRIA, LOUISIANA, USA